


THIS DRAWING CONTAINS TRADE INFORMATION DEEMED TO BE CONFIDENTIAL AND PROPRIETARY PROPERTY OF MIDDLE ATLANTIC PRODUCTS, INC. AND IS TO BE USED ONLY FOR THE PURPOSES FOR WHICH IT IS SUBMITTED AND FURTHER SHALL NOT BE COPIED IN WHOLE OR PART WITHOUT WRITTEN PERMISSION FIRST OBTAINED FROM MIDDLE ATLANTIC PRODUCTS, INC.


REV	DESCRIPTION	REV BY	REV DATE	APP'D BY	DATE APP.
E	SEE EC 033004-05	BKW	11/30/04	JW	12/06/04
F	SEE EC 031005-03	RBM	04/18/05	JJP	04/21/05
G	SEE EC 010406-01	RR1	01/19/06	RE	01/19/06

A
B
C
D
E


REAR VIEW

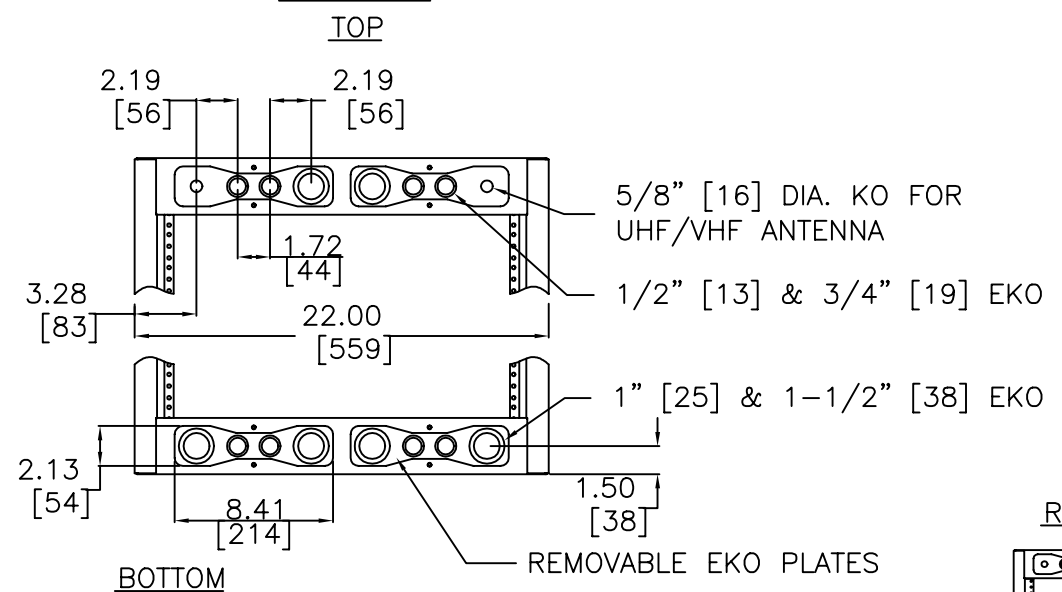


TOP VIEW

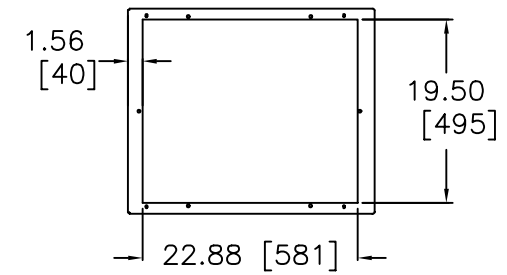


BOTTOM VIEW

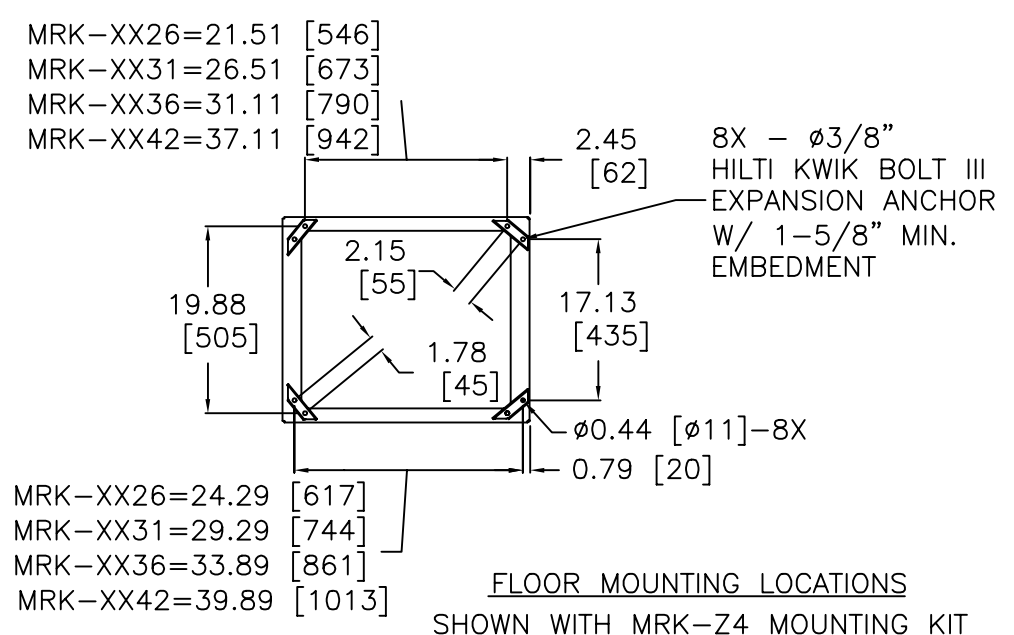


REAR VIEW

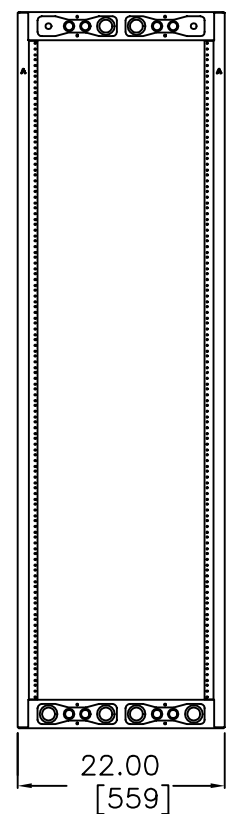



SIDE VIEW

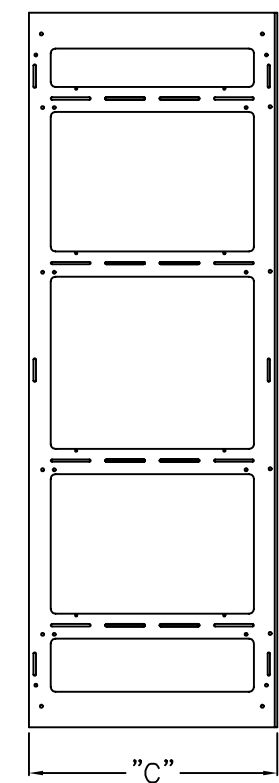

FRONT VIEW

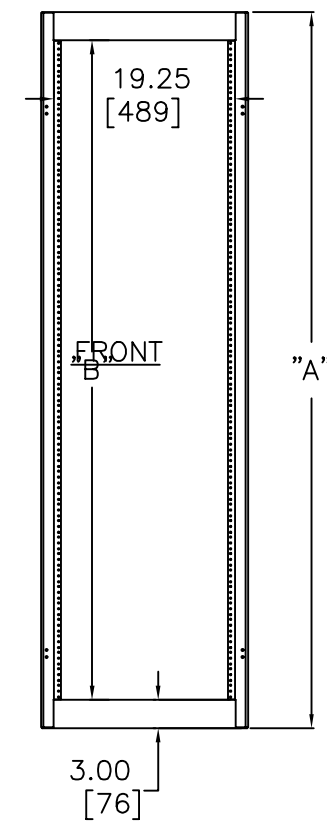


TOP SIDE VIEW

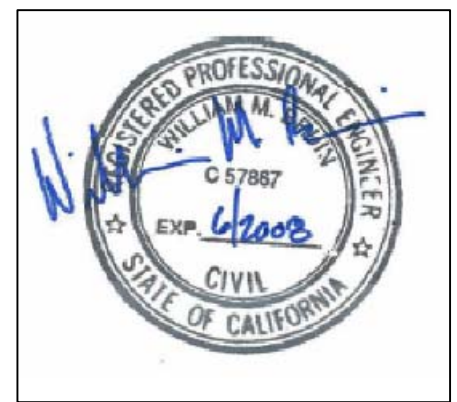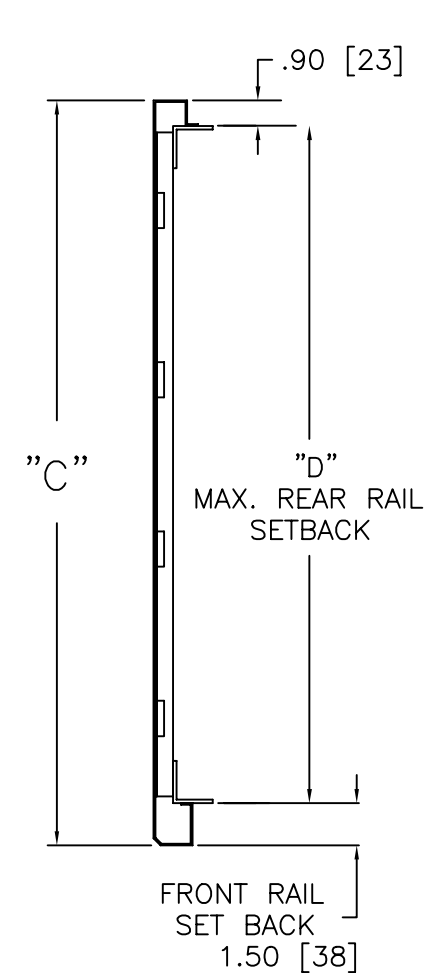

NOTE: SEE PAGE 2 FOR ALL APPLICABLE OSHPD NOTES

OPA-1338 Pg. 1 of 4

PART #	"A"	"B"	"C"	"D"
MRK-4426	83.13[2112]	77.13[1959]	26.40[671]	24.00[610]
MRK-4026	76.13[1934]	70.13[1781]	26.40[671]	24.00[610]
MRK-3726	70.88[1800]	64.88[1648]	26.40[671]	24.00[610]
MRK-2426	48.13[1223]	42.13[1070]	26.40[671]	24.00[610]
MRK-4431	83.13[2112]	77.13[1959]	31.40[798]	29.00[737]
MRK-4031	76.13[1934]	70.13[1781]	31.40[798]	29.00[737]
MRK-3731	70.88[1800]	64.88[1648]	31.40[798]	29.00[737]
MRK-2431	48.13[1223]	42.13[1070]	31.40[798]	29.00[737]
MRK-4436	83.13[2112]	77.13[1959]	36.00[914]	33.60[853]
MRK-4036	76.13[1934]	70.13[1781]	36.00[914]	33.60[853]
MRK-4442	83.13[2112]	77.13[1959]	42.00[1067]	39.60[1006]
MRK-4042	76.13[1934]	70.13[1781]	42.00[1067]	39.60[1006]

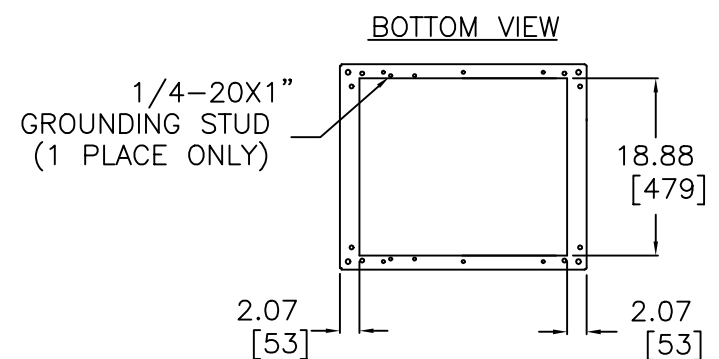

NOTE: DIMENSION FORMAT SHOWN IN [MM].

USED ON:	APPROVALS	DATE	Middle Atlantic Products, Inc.	
--	MODELED TLR	09/17/98	TITLE MRK SERIES ENCLOSURE	
--	DRAWN TLR	09/17/98		
NEXT ASSY:	CIRCLED DIMENSIONS ARE CRITICAL INSPECTION DIMENSIONS		PART NO.	PART REV
--	UNLESS OTHERWISE SPECIFIED, ALL DIMENSIONS ARE IN INCHES		96-039_OSHPD	-
MATERIAL:	TOLERANCES ARE:		SIZE	DXF NO.
COLD ROLLED STEEL	DECIMAL: 2 PLC ±.03		B	NONE
	3 PLC ±.010		DWG NO.	DWG REV
	FRACTIONS: ±1/32		96-039_OSHPD	G
FINISH:	ANGLES: ±1°			
BLACK WRINKLE	SCALE = 1/1			
	SHEET 1 OF 2			

THIS DRAWING CONTAINS TRADE INFORMATION DEEMED TO BE CONFIDENTIAL AND PROPRIETARY PROPERTY OF MIDDLE ATLANTIC PRODUCTS, INC. AND IS TO BE USED ONLY FOR THE PURPOSES FOR WHICH IT IS SUBMITTED AND FURTHER SHALL NOT BE COPIED IN WHOLE OR PART WITHOUT WRITTEN PERMISSION FIRST OBTAINED FROM MIDDLE ATLANTIC PRODUCTS, INC.

GENERAL

1. THE WORK SHOWN ON THESE DRAWINGS IS FOR THE SEISMIC ANCHORAGE OF THE SUBJECT RACK ENCLOSURES. MAXIMUM CONTENT CAPACITIES FOR VARIOUS HEIGHTS WITHIN THE BUILDING ARE PROVIDED.
2. THE WORK SHOWN HAS BEEN PRE-APPROVED BY OSHPD UNDER NUMBER OPA-1338.
3. ANCHORAGE DESIGN HAS BEEN DONE IN ACCORDANCE WITH THE 2001 EDITION OF THE CALIFORNIA BUILDING CODE, VOLUME 2A. USING THE FOLLOWING PARAMETERS:

$A_p = 1.0$
 $R_p = 1.5$ (SHALLOW ANCHORS)
 $I_p = 1.5$ (ESSENTIAL FACILITY INSTALLATIONS)
 $N_a = 1.5$ (TYPE A FAULT < 2 KM FROM SITE)
 $C_a = 0.44 \times N_a = 0.66$ (SOIL TYPE Sd)
 $H_x/H_r =$ VARIES PER TABLE

INSTALLATION NOTES

1. THE MAXIMUM SEISMIC CONTENT CAPACITY OF THE RACK ENCLOSURE IS PROVIDED IN THE CAPACITY TABLE PROVIDED ON THESE DRAWINGS. THE STRUCTURAL ENGINEER-OF-RECORD (SEOR) SHALL VERIFY THAT THE WEIGHT OF RACK ENCLOSURE CONTENTS DOES NOT EXCEED THE APPROVED CAPACITY FOR THE LOCATION OF INSTALLATION.
2. THE SEOR SHALL VERIFY THAT THE EXISTING STRUCTURE IS ADEQUATE TO SUPPORT THE LOADS AND REACTIONS IMPOSED BY THE ANCHORED RACK ENCLOSURE IN ADDITION TO ALL OTHER LOADS AND FORCES.
3. RACK ENCLOSURES MAY BE ANCHORED TO EITHER A NORMAL-WEIGHT, REINFORCED CONCRETE FLOOR OR SLAB WITH A MINIMUM THICKNESS OF 4 INCHES AND A MINIMUM CONCRETE COMPRESSIVE STRENGTH (F'C) OF 3,000 PSI OR ALTERNATIVELY TO A LIGHT-WEIGHT, REINFORCED CONCRETE FILL OVER A METAL DECK WITH A MINIMUM THICKNESS OF 3-1/4" AND A MINIMUM F'C= 3,000 PSI. DOCUMENTATION VERIFYING CONCRETE STRENGTH SHALL BE SUBMITTED TO THE ENFORCEMENT AGENCY.
4. INSTALLATION OF THE RACK ENCLOSURES IS LIMITED TO INTERIOR OR ENVIRONMENTALLY PROTECTED LOCATIONS.

RACK ENCLOSURE CAPACITY TABLE

Maximum Content Capacity (pounds) (1),(2)

RACK empty Enclosure weight	Location in Building (hx/hr)			
	Ground	1/3	2/3	Roof
MRK-4426 123	900	775	425	275
MRK-4026 118	900	870	485	315
MRK-3726 114	900	900	535	350
MRK-2426 82	900	900	880	595
MRK-4431 136	900	800	440	275
MRK-4031 128	900	900	500	325
MRK-3731 124	900	900	555	360
MRK-2431 88	900	900	900	615
MRK-4436 146	900	820	445	280
MRK-4036 140	900	900	500	325
MRK-4442 154	900	835	455	280
MRK-4042 146	900	900	520	330

- (1) ENCLOSURES SHALL BE ANCHORED WITH MRK-Z4 MOUNTING KIT.
- (2) ENCLOSURE contents shall be distributed within the rack such that 50% of the total weight is located within the bottom third of the rack enclosure height, 25% in the middle third, and 25% in the top third.



CONCRETE ANCHOR NOTES

1. CONCRETE ANCHORS SHALL BE HILTI KWIK BOLT III CONCRETE ANCHORS WITH CARBON STEEL STUDS AS MANUFACTURED BY HILTI, INC. WITH DIAMETER, EMBEDMENT, AND SPACING AS SHOWN ON THE DRAWINGS. (ICC ESR 1355 OR 1385)
2. LOCATE ALL EXISTING REINFORCING BARS WITHIN 12 INCHES OF PROPOSED ANCHOR LOCATIONS PRIOR TO DRILLING FOR CONCRETE ANCHORS. DO NOT CUT, CORE, OR DRILL THROUGH EXISTING REINFORCING BARS WITHOUT PRIOR APPROVAL FROM THE SEOR.
3. ALL CONCRETE ANCHORS SHALL BE INSTALLED WITH PROPER TOOLS AND PROCEDURES IN STRICT ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS.
4. TENSION TESTING SHALL OCCUR 24 HOURS OR MORE AFTER INSTALLATION OF THE CONCRETE ANCHORS.
5. APPLY TENSION TEST LOADS TO THE CONCRETE ANCHORS WITHOUT REMOVING THE NUT. IF NUT REMOVAL IS REQUIRED, REMOVE THE NUT AND INSTALL A THREADED COUPLER TO THE SAME TORQUE AS THE ORIGINAL NUT USING A TORQUE WRENCH AND THEN APPLY THE TEST LOAD.
6. REACTION LOADS FROM TEST FIXTURES MAY BE APPLIED IN CLOSE PROXIMITY TO THE ANCHOR BEING TESTED PROVIDED THE ANCHOR IS NOT RESTRAINED FROM WITHDRAWING BY THE FIXTURES.
7. TEST EQUIPMENT SHALL BE CALIBRATED BY AN APPROVED TESTING LABORATORY IN ACCORDANCE WITH STANDARD RECOGNIZED PROCEDURES.
8. ONE HALF OF EACH APPLICATION OF CONCRETE ANCHORS SHALL BE TESTED IN TENSION FOR 3 MINUTES ACCORDING TO THE TEST LOADS SHOWN BELOW. ONE APPLICATION OF ANCHORS SHALL BE DEFINED AS THOSE ANCHORS INSTALLED BY A SINGLE CREW IN A SINGLE DAY. IF ANY ANCHOR FAILS, IT SHALL BE REPLACED, RE-TESTED, AND ALL ANCHORS IN THE SAME APPLICATION SHALL BE TESTED. IF ANY ANCHOR FAILS, ALL PREVIOUSLY UNTESTED ANCHORS INSTALLED BY THAT CREW SHALL BE TESTED UNTIL TWENTY (20) CONSECUTIVE ANCHORS PASS, THEN RESUME 50% TESTING.

CONCRETE ANCHORS TEST LOADS

ANCHOR DIAMETER (INCHES)	MINIMUM EMBEDMENT (INCHES)	TENSION TEST LOAD (LBS)
3/8	1-5/8	1,210

9. TENSION TESTING OF THE CONCRETE ANCHORS SHALL BE DONE IN THE PRESENCE OF THE INSPECTOR-OF-RECORD AND A REPORT OF THE TEST RESULTS SHALL BE SUBMITTED TO THE ENFORCEMENT AGENCY.
10. THE TENSION TEST OF AN ANCHOR SHALL BE ACCEPTED IF THERE IS NO OBSERVABLE MOVEMENT DURING THE APPLICATION OF THE TEST LOAD. A PRACTICAL WAY TO DETECT OBSERVABLE MOVEMENT IS WHETHER THE WASHER UNDER THE NUT BECOMES LOOSE.

HOW TO USE THIS PRE-APPROVAL


1. THE SEOR SHALL DETERMINE THE FOLLOWING:
 - A. THE MODEL NUMBER OF THE UNIT TO BE USED.
 - B. THE ELEVATION OF THE ROOF, hr.
 - C. THE ELEVATION OF THE FLOOR WHERE THE UNIT WILL BE INSTALLED ON, hx.
2. THE SEOR SHALL THEN DETERMINE THE RATIO OF hx/hr AND CONSULT THE TABLE IN GENERAL NOTE 4 ON DRAWING 2 OR 4 TO DETERMINE THE MAXIMUM WEIGHT OF THE CONTENTS THAT CAN BE STORED ON THE RACK.
3. SEOR SHALL VERIFY THAT A PLACARD IS PLACED ON THE RACK STATING THE FOLLOWING:
 - A. UNIT MODEL NUMBER.
 - B. NAME OF THE BUILDING IN WHICH IT WILL BE INSTALLED.
 - C. HIGHEST FLOOR WHERE IT CAN BE USED.
 - D. MAXIMUM WEIGHT OF THE CONTENTS THAT CAN BE STORED ON THE RACK.
 - E. A PROMINENT WARNING TO STORE THE HEAVIEST ITEMS ON THE LOWER LEVELS OF THE RACK.
4. SEOR SHALL VERIFY THAT THE CONCRETE FLOOR MEETS THE REQUIREMENTS OF THIS PRE-APPROVAL.
5. SEOR SHALL VERIFY THAT THE EXISTING STRUCTURE IS ADEQUATE TO SUPPORT THE LOADS AND FORCES IMPOSED ON IT BY THIS UNIT IN ADDITION TO ALL OTHER LOADS AND FORCES.

USED ON:	APPROVALS	DATE	Middle Atlantic Products, Inc
--	MODELED TLR	09/17/98	
NEXT ASSY:	DRAWN TLR	09/17/98	TITLE
--	CIRCLED DIMENSIONS ARE CRITICAL		MRK
MATERIAL:	UNLESS OTHERWISE SPECIFIED, ALL DIMENSIONS ARE IN INCHES		SERIES ENCLOSURE
COLD ROLLED STEEL	TOLERANCES ARE: DECIMAL: 2 PLC ±.03 3 PLC ±.010		PART NO. 96-039_OSHPD
FINISH:	FRACTIONS: ±1/32		SIZE B
BLACK WRINKLE	ANGLES: ±1°		DXF NO. NONE
	SCALE = 1/1		DWG NO. 96-039_OSHPD
	SHEET 2 OF 2		DWG REV 6




THIS DRAWING CONTAINS TRADE INFORMATION DEEMED TO BE CONFIDENTIAL AND PROPRIETARY PROPERTY OF MIDDLE ATLANTIC PRODUCTS, INC. AND IS TO BE USED ONLY FOR THE PURPOSES FOR WHICH IT IS SUBMITTED AND FURTHER SHALL NOT BE COPIED IN WHOLE OR PART WITHOUT WRITTEN PERMISSION FIRST OBTAINED FROM MIDDLE ATLANTIC PRODUCTS, INC.

REV	DESCRIPTION	REV BY	REV DATE	APP'D BY	DATE APP.
-	PRODUCTION RELEASE	////	////	JP	04/01/04
A	SEE EC 050205-01	AP	05/03/05	BW	05/03/05



A

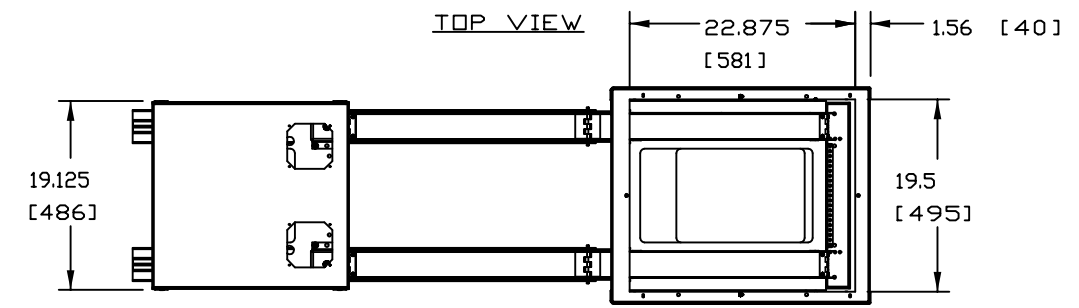


B

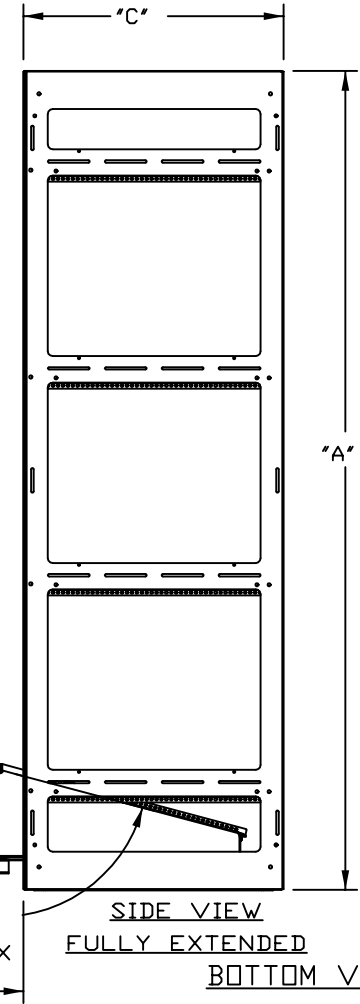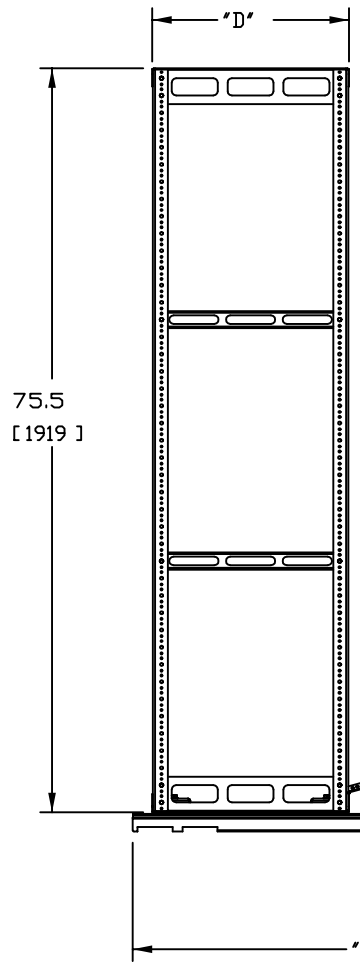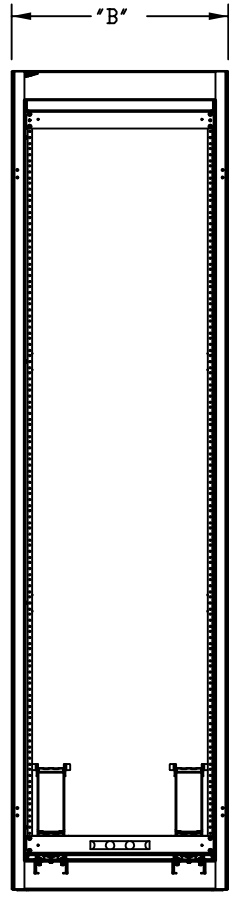

NOTE: SEE PAGE 2 FOR ALL APPLICABLE OSHPD NOTES

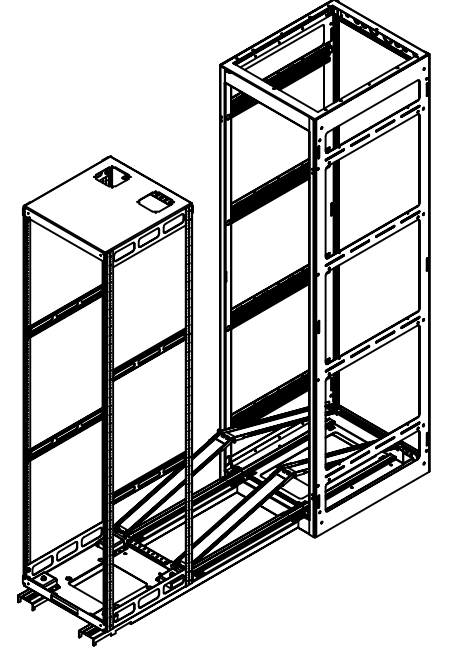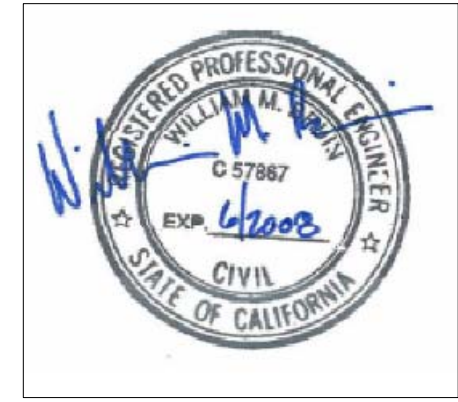

C


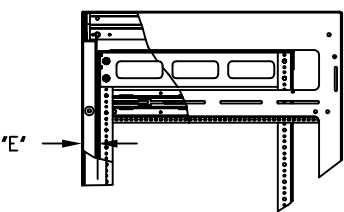


D

MODEL NO	USEABLE RACKING HEIGHT	HOST CABINET OVERALL HEIGHT 'A'	HOST CABINET OVERALL WIDTH 'B'	HOST CABINET OVERALL DEPTH 'C'	FRAME DEPTH 'D'	MINIMUM RAIL SETBACK 'E' ***	FRAME ROLL OUT 'F'
MRK-4426AXS-Z4	41	83.125 [2111]	22 [559] *	26.4 [671]	20 [508]	1.5 [38]	47.5 [1207] TO 48.5 [1232]
MRK-4026AXS-Z4	37	76.125 [1934]	22 [559] *	26.4 [671]	20 [508]	1.5 [38]	47.5 [1207] TO 48.5 [1232]
MRK-3726AXS-Z4	34	70.875 [1800]	22 [559] *	26.4 [671]	20 [508]	1.5 [38]	47.5 [1207] TO 48.5 [1232]

MRK-XX26=21.51 [546]
MRK-XX31=26.51 [673]
MRK-XX36=31.11 [790]
MRK-XX42=37.11 [942]

E

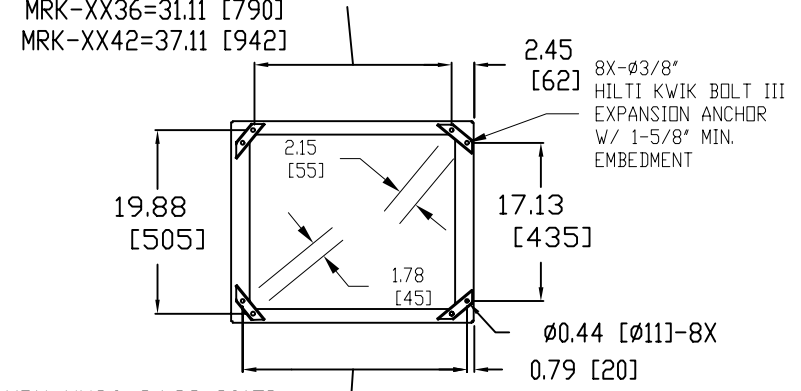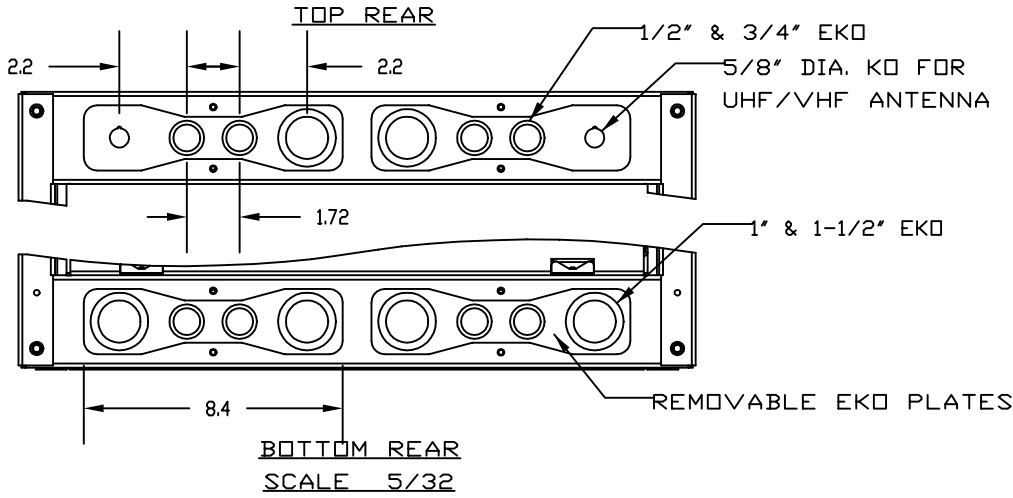

MRK-XX26=24.29 [617]
MRK-XX31=29.29 [744]
MRK-XX36=33.89 [861]
MRK-XX42=39.89 [1013]

FLOOR MOUNTING LOCATIONS SHOWN WITH MRK-Z4 MOUNTING KIT

* SIDE PANELS ADD .625 [15,9] TO EACH SIDE WHERE APPLICABLE
** MINIMUM RAIL SETBACK SHOWN. MAXIMUM RAIL SETBACK IS 2.5 [64]

USED ON	APPROVALS	DATE	
MRK-4426AXS	MODELED AP	04/01/04	
	DRAWN AP	04/01/04	
NEXT ASSY:	CIRCLED DIMENSIONS ARE CRITICAL INSPECTION DIMENSIONS UNLESS OTHERWISE SPECIFIED, ALL DIMENSIONS ARE IN INCHES TOLERANCES ARE: DECIMAL: 2 PLC ±.03 3 PLC ±.010 FRACTIONS: ±1/32 ANGLES: ±1°		TITLE
MATERIAL:	SCALE = 3/64		MRK AXS SYSTEM
FINISH:	SHEET 1 OF 2		PART NO. 96-055S_QSHPD PART REV -
			SIZE B DXF NO. NONE
			DWG NO. 96-055S_QSHPD DWG REV A

THIS DRAWING CONTAINS TRADE INFORMATION DEEMED TO BE CONFIDENTIAL AND PROPRIETARY PROPERTY OF MIDDLE ATLANTIC PRODUCTS, INC. AND IS TO BE USED ONLY FOR THE PURPOSES FOR WHICH IT IS SUBMITTED AND FURTHER SHALL NOT BE COPIED IN WHOLE OR PART WITHOUT WRITTEN PERMISSION FIRST OBTAINED FROM MIDDLE ATLANTIC PRODUCTS, INC.

GENERAL

1. THE WORK SHOWN ON THESE DRAWINGS IS FOR THE SEISMIC ANCHORAGE OF THE SUBJECT RACK ENCLOSURES. MAXIMUM CONTENT CAPACITIES FOR VARIOUS HEIGHTS WITHIN THE BUILDING ARE PROVIDED.
2. THE WORK SHOWN HAS BEEN PRE-APPROVED BY OSHPD UNDER NUMBER OPA-1338.
3. ANCHORAGE DESIGN HAS BEEN DONE IN ACCORDANCE WITH THE 2001 EDITION OF THE CALIFORNIA BUILDING CODE, VOLUME 2A. USING THE FOLLOWING PARAMETERS:

$A_p = 1.0$
 $R_p = 1.5$ (SHALLOW ANCHORS)
 $I_p = 1.5$ (ESSENTIAL FACILITY INSTALLATIONS)
 $N_a = 1.5$ (TYPE A FAULT < 2 KM FROM SITE)
 $C_a = 0.44 \times N_a = 0.66$ (SOIL TYPE Sd)
 $H_x/H_r =$ VARIES PER TABLE

INSTALLATION NOTES

1. THE MAXIMUM SEISMIC CONTENT CAPACITY OF THE RACK ENCLOSURE IS PROVIDED IN THE CAPACITY TABLE PROVIDED ON THESE DRAWINGS. THE STRUCTURAL ENGINEER-OF-RECORD (SEOR) SHALL VERIFY THAT THE WEIGHT OF RACK ENCLOSURE CONTENTS DOES NOT EXCEED THE APPROVED CAPACITY FOR THE LOCATION OF INSTALLATION.
2. THE SEOR SHALL VERIFY THAT THE EXISTING STRUCTURE IS ADEQUATE TO SUPPORT THE LOADS AND REACTIONS IMPOSED BY THE ANCHORED RACK ENCLOSURE IN ADDITION TO ALL OTHER LOADS AND FORCES.
3. RACK ENCLOSURES MAY BE ANCHORED TO EITHER A NORMAL-WEIGHT, REINFORCED CONCRETE FLOOR OR SLAB WITH A MINIMUM THICKNESS OF 4 INCHES AND A MINIMUM CONCRETE COMPRESSIVE STRENGTH (F'c) OF 3,000 PSI OR ALTERNATIVELY TO A LIGHT-WEIGHT, REINFORCED CONCRETE FILL OVER A METAL DECK WITH A MINIMUM THICKNESS OF 3-1/4" AND A MINIMUM F'c= 3,000 PSI. DOCUMENTATION VERIFYING CONCRETE STRENGTH SHALL BE SUBMITTED TO THE ENFORCEMENT AGENCY.
4. INSTALLATION OF THE RACK ENCLOSURES IS LIMITED TO INTERIOR OR ENVIRONMENTALLY PROTECTED LOCATIONS.

RACK ENCLOSURE CAPACITY TABLE

Maximum Content Capacity (pounds) (1),(2)

RACK Enclosure	Location in Building (hx/hr) empty weight	Location in Building (hx/hr)			
		Ground	1/3	2/3	Roof
MRK-4426AXS-Z4	165	500	500	385	230
MRK-4026AXS-Z4	161	500	500	440	270
MRK-3726AXS-Z4	155	500	500	495	310

- (1) ENCLOSURES SHALL BE ANCHORED WITH MRK-Z4 MOUNTING KIT.
- (2) ENCLOSURE contents shall be distributed within the rack such that 50% of the total weight is located within the bottom third of the rack enclosure height, 25% in the middle third, and 25% in the top third.

CONCRETE ANCHOR NOTES

1. CONCRETE ANCHORS SHALL BE HILTI KWIK BOLT III CONCRETE ANCHORS WITH CARBON STEEL STUDS AS MANUFACTURED BY HILTI, INC. WITH DIAMETER, EMBEDMENT, AND SPACING AS SHOWN ON THE DRAWINGS. (ICC ESR 1355 OR 1385)
2. LOCATE ALL EXISTING REINFORCING BARS WITHIN 12 INCHES OF PROPOSED ANCHOR LOCATIONS PRIOR TO DRILLING FOR CONCRETE ANCHORS. DO NOT CUT, CORE, OR DRILL THROUGH EXISTING REINFORCING BARS WITHOUT PRIOR APPROVAL FROM THE SEOR.
3. ALL CONCRETE ANCHORS SHALL BE INSTALLED WITH PROPER TOOLS AND PROCEDURES IN STRICT ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS.
4. TENSION TESTING SHALL OCCUR 24 HOURS OR MORE AFTER INSTALLATION OF THE CONCRETE ANCHORS.
5. APPLY TENSION TEST LOADS TO THE CONCRETE ANCHORS WITHOUT REMOVING THE NUT. IF NUT REMOVAL IS REQUIRED, REMOVE THE NUT AND INSTALL A THREADED COUPLER TO THE SAME TORQUE AS THE ORIGINAL NUT USING A TORQUE WRENCH AND THEN APPLY THE TEST LOAD.
6. REACTION LOADS FROM TEST FIXTURES MAY BE APPLIED IN CLOSE PROXIMITY TO THE ANCHOR BEING TESTED PROVIDED THE ANCHOR IS NOT RESTRAINED FROM WITHDRAWING BY THE FIXTURES.
7. TEST EQUIPMENT SHALL BE CALIBRATED BY AN APPROVED TESTING LABORATORY IN ACCORDANCE WITH STANDARD RECOGNIZED PROCEDURES.
8. ONE HALF OF EACH APPLICATION OF CONCRETE ANCHORS SHALL BE TESTED IN TENSION FOR 3 MINUTES ACCORDING TO THE TEST LOADS SHOWN BELOW. ONE APPLICATION OF ANCHORS SHALL BE DEFINED AS THOSE ANCHORS INSTALLED BY A SINGLE CREW IN A SINGLE DAY. IF ANY ANCHOR FAILS, IT SHALL BE REPLACED, RE-TESTED, AND ALL ANCHORS IN THE SAME APPLICATION SHALL BE TESTED. IF ANY ANCHOR FAILS, ALL PREVIOUSLY UNTESTED ANCHORS INSTALLED BY THAT CREW SHALL BE TESTED UNTIL TWENTY (20) CONSECUTIVE ANCHORS PASS, THEN RESUME 50% TESTING.


CONCRETE ANCHORS TEST LOADS

ANCHOR DIAMETER (INCHES)	MINIMUM EMBEDMENT (INCHES)	TENSION TEST LOAD (LBS)
3/8	1-5/8	1,210

9. TENSION TESTING OF THE CONCRETE ANCHORS SHALL BE DONE IN THE PRESENCE OF THE INSPECTOR-OF-RECORD AND A REPORT OF THE TEST RESULTS SHALL BE SUBMITTED TO THE ENFORCEMENT AGENCY.
10. THE TENSION TEST OF AN ANCHOR SHALL BE ACCEPTED IF THERE IS NO OBSERVABLE MOVEMENT DURING THE APPLICATION OF THE TEST LOAD. A PRACTICAL WAY TO DETECT OBSERVABLE MOVEMENT IS WHETHER THE WASHER UNDER THE NUT BECOMES LOOSE.

HOW TO USE THIS PRE-APPROVAL

1. THE SEOR SHALL DETERMINE THE FOLLOWING:
 - A. THE MODEL NUMBER OF THE UNIT TO BE USED.
 - B. THE ELEVATION OF THE ROOF, hr.
 - C. THE ELEVATION OF THE FLOOR WHERE THE UNIT WILL BE INSTALLED ON, hx.
2. THE SEOR SHALL THEN DETERMINE THE RATIO OF hx/hr AND CONSULT THE TABLE IN GENERAL NOTE 4 ON DRAWING 2 OR 4 TO DETERMINE THE MAXIMUM WEIGHT OF THE CONTENTS THAT CAN BE STORED ON THE RACK.
3. SEOR SHALL VERIFY THAT A PLACARD IS PLACED ON THE RACK STATING THE FOLLOWING:
 - A. UNIT MODEL NUMBER.
 - B. NAME OF THE BUILDING IN WHICH IT WILL BE INSTALLED.
 - C. HIGHEST FLOOR WHERE IT CAN BE USED.
 - D. MAXIMUM WEIGHT OF THE CONTENTS THAT CAN BE STORED ON THE RACK.
 - E. A PROMINENT WARNING TO STORE THE HEAVIEST ITEMS ON THE LOWER LEVELS OF THE RACK.
4. SEOR SHALL VERIFY THAT THE CONCRETE FLOOR MEETS THE REQUIREMENTS OF THIS PRE-APPROVAL.
5. SEOR SHALL VERIFY THAT THE EXISTING STRUCTURE IS ADEQUATE TO SUPPORT THE LOADS AND FORCES IMPOSED ON IT BY THIS UNIT IN ADDITION TO ALL OTHER LOADS AND FORCES.

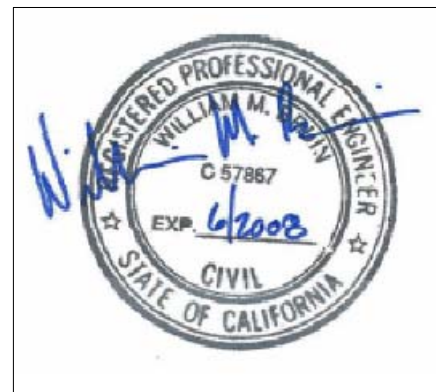

USED ON	APPROVALS	DATE	TITLE	
MRK-4426AXS	MODELED AP	04/01/04	MRK AXS SYSTEM	
	DRAWN AP	04/01/04		
NEXT ASSY:	CIRCLED DIMENSIONS ARE CRITICAL INSPECTION DIMENSIONS UNLESS OTHERWISE SPECIFIED, ALL DIMENSIONS ARE IN INCHES		PART NO.	96-055S_OSHPD
MATERIAL:	TOLERANCES ARE: DECIMAL: 2 PLC ±.03 3 PLC ±.010		SIZE	B
FINISH:	FRACTIONS: 1/32 ANGLES: ±1°		DXF NO.	NONE
	SCALE = 3/64		DWG NO.	96-055S_OSHPD
	SHEET 2 OF 2		DWG REV	A

